


General


Deviations of rated values at site altitudes > 1000 m

Reduction of the rated voltage and rated current, depending on the site altitude and coolant temperature

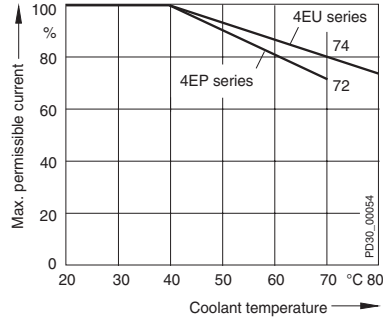


Deviation of the permissible direct current of rated direct current I_{dn} , or permissible alternating current of rated alternating current I_n (at coolant temperatures $\neq 40^\circ\text{C}$)

Characteristic curve 74 applies to reactors 4EU, 4ET, 4PK
Characteristic curve 72 applies to reactors 4EP, 4EM, 4EF11

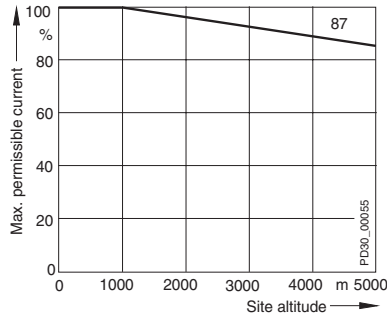

Deviation of permissible direct current of rated direct current I_{dn} , or permissible alternating current of rated alternating current I_n (at site altitudes > 1000 m above sea level)

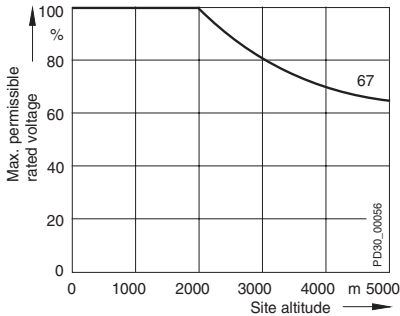

Reduction of rated voltage for insulation (at site altitudes > 2000 m above sea level)


Inductance curve

Commutating reactors and mains reactors


Commutating reactors and mains reactors differ greatly with regard to the inductance curve. The inductance is almost constant through to the rated current I_{Ln} .

- Mains reactors still have 90% of their rated inductance at a 1.6-fold rated current I_{Ln} .
- Commutating reactors have a residual inductance of 60% at a 2.0-fold rated current I_{Ln} .

Typical inductance curves over the reactor current are shown in the following illustrations:

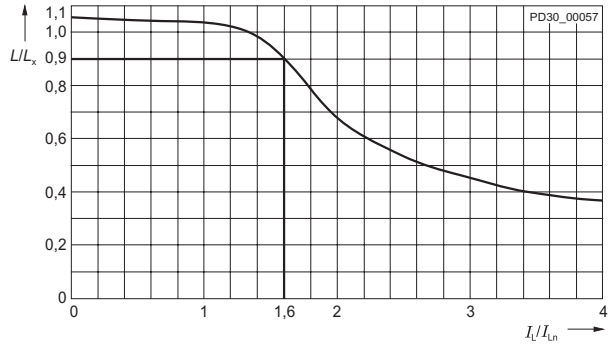

Typical curve of the inductance of a **mains reactor** over the reactor current

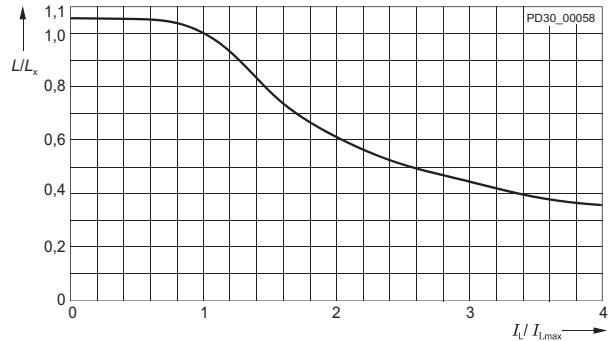

Typical curve of the inductance of a **commutating reactor** over the reactor current

Voltage drop ΔU or reference voltage drop u_D

In the case of **three-phase reactors**, the voltage drop ΔU per reactor phase when loaded with the maximum continuous thermal current I_{thmax} and line frequency $f = 50$ Hz or 60 Hz.

The percent voltage drop u_D can be calculated using the following formula:

For converter connection B6

$$u_D = \frac{\Delta U \times 100 \times \sqrt{3}}{U_N} \quad \text{in \%}$$

The inductance per reactor phase is as follows:

$$L_x = \frac{\Delta U}{I_{thmax} \times \omega}$$

$$\omega = 2 \pi \times f$$


with f = line frequency (50 Hz or 60 Hz)

Recommended supply voltage U_N , reference voltage drop u_D and insulation rating



The "Selection and ordering data" table specifies a recommended supply voltage U_N for the reactors. The percent voltage drops u_D assigned to the reactors apply to the relevant recommended supply voltage U_N .

The rated voltage for the insulation specified in the "Selection and ordering data" table also allows the use of reactors at voltages that deviate from the recommended supply voltage U_N , but that are smaller or the same as the rated voltage of the insulation. The reference voltage drop u_D then changes and can be calculated using the formula shown in the Section "Voltage drop ΔU or reference voltage drop u_D ".


A reactor with the reference voltage drop u_D specified as a percent value has the same effect on the system as a transformer with the same u_K .

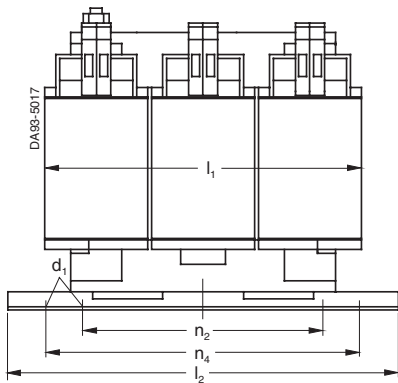

4EP ≤ 40 A

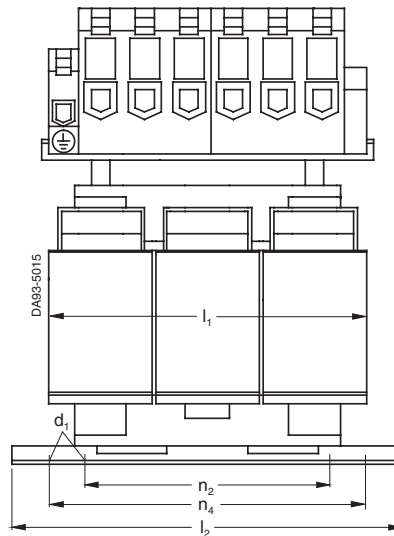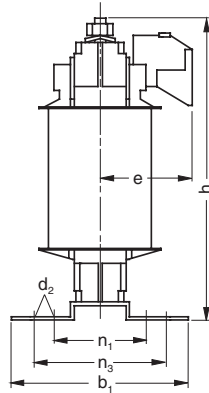

4EP 41 A to 50 A

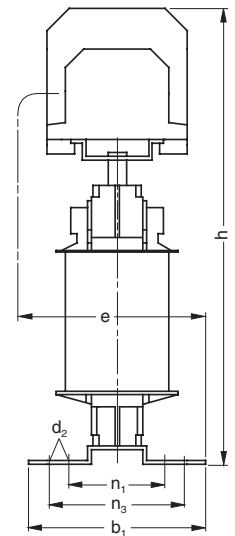

Terminal RKW110 or TRKSD10

(for $I_{LN} \leq 40$ A)

Cross-sections: solid: 1 mm² to 16 mm²
finely stranded: 1 mm² to 10 mm²

Earth stud M6 x 12

Cross-sections: solid: 2.5 mm² to 10 mm²
finely stranded: 4 mm² to 10 mm²

Terminal 8WA1 304

(for $I_{LN} = 41$ to 50 A)

Cross-sections: solid: 1 mm² to 16 mm²
stranded: 10 mm² to 25 mm²
finely stranded: 2.5 mm² to 16 mm²


Corresponding earth terminal EK16/35

Cross-sections: solid: 2.5 mm² to 16 mm²
finely stranded: 4 mm² to 16 mm²

Type	Rated alternating current I_{LN}	b_1	d_1	d_2	d_3	e	h	l_1	l_2	n_1	n_2	n_3	n_4
Rated alternating currents for terminal connections													
4EP36	up to 40 A	78	4.8	9	M4	62.0	139	120	148	49	90	58	136
4EP37	up to 40 A	73	5.8	11	M5	60.0	159	150	178	49	113	53	166
4EP38	up to 40 A	88	5.8	11	M5	67.0	159	150	178	64	113	68	166
4EP39	up to 40 A	99	7.0	13	M6	62.0	181	182	219	56	136	69	201
4EP40	up to 40 A	119	7.0	13	M6	72.0	181	182	219	76	136	89	201
4EP37	41 – 50 A	73	5.8	11	M5	78.5	193	150	178	49	113	53	166
4EP38	41 – 50 A	88	5.8	11	M5	86.0	193	150	178	64	113	68	166
4EP39	41 – 50 A	99	7.0	13	M6	91.5	220	182	219	56	136	69	201
4EP40	41 – 50 A	119	7.0	13	M6	101.5	220	182	219	76	136	89	201


Arrangement of 4EP reactors:

- User-defined for commutating reactors
- For iron-core output reactors, see drawing







airflow

Permissible arrangement of iron-core output reactors, vertical



airflow

Permissible arrangement of iron-core output reactors, horizontal

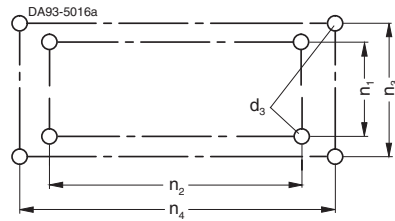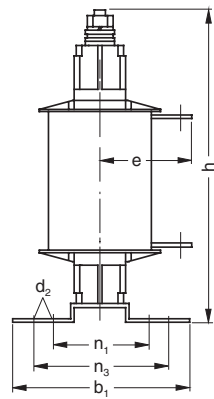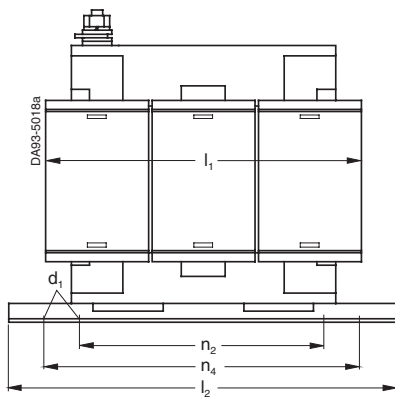

4EP > 51 A




Earth stud M6 x 12
for connection of cables with ring terminal end

Mounting holes

n_1 and n_2 mounting holes according to DIN 41308
 n_3 and n_4 mounting holes according to EN 60852-4

Flat termination




Type	Rated alternating current I_{Ln}	b_1	d_1	d_2	d_3	e	h	l_1	l_2	n_1	n_2	n_3	n_4
Rated alternating currents for flat termination													
4EP37	over 51 A	73	5.8	11	M5	68	153	150	178	49	113	53	166
4EP38	over 51 A	88	5.8	11	M5	76	153	150	178	64	113	68	166
4EP39	over 51 A	99	7.0	13	M6	73	179	182	219	56	136	69	201
4EP40	over 51 A	119	7.0	13	M6	83	179	182	219	76	136	89	201

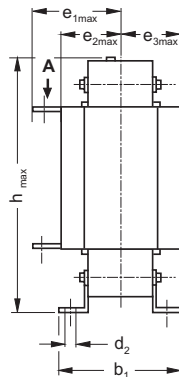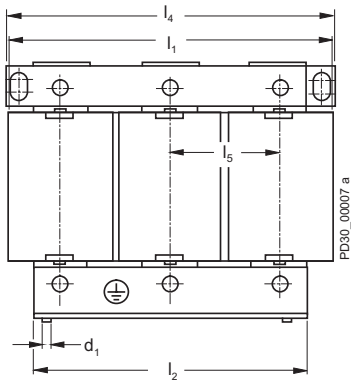

4EU24 to 4EU36

Mounting holes


Type	b_1	d_1	d_2	d_3	e_{1max}	e_{2max}	e_{3max}	h_{max}	l_1	l_2	l_4	l_5	n_1	n_2	Earth
for 4EU24 to 4EU36 with flat terminations, for arrangement of reactors on horizontal surfaces															
4EU24	91	7	12	M6	90.5	56.5	48.5	210	225	190	–	76	70	176	M6
4EU25	115	7	12	M6	102.5	68.5	60.5	210	225	190	–	76	94	176	M6
4EU27	133	10	18	M8	120.5	79.5	67.5	248	260	220	270	88	101	200	M6
4EU30 (Cu)	148	10	18	M8	137.0	89.0	73.0	269	295	250	300	100	118	224	M6
4EU30	148	10	18	M8	144.0	98.0	86.0	269	295	250	300	100	118	224	M6
4EU36 (Cu)	169	10	18	M8	142.0	94.0	78.0	321	357	300	350	120	138	264	M8
4EU36	169	10	18	M8	161.0	111.0	91.0	321	357	300	350	120	138	264	M8

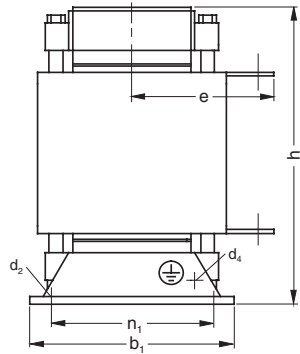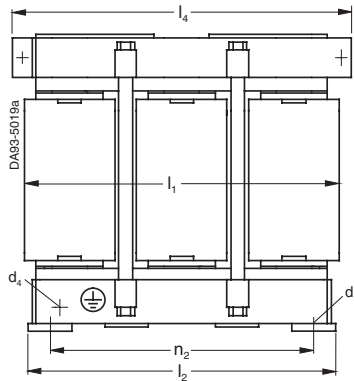


4EU39 to 4EU51

Mounting holes

Type	b ₁	d ₁	d ₂	d ₃	e _{1 max}	e _{2 max}	e _{3 max}	h _{max}	l ₁	l ₂	l ₄	l ₅	n ₁	n ₂	Earth	
for 4EU39 to 4EU51 with flat terminations, for arrangement of reactors on horizontal surfaces																
4EU39	174	12.0	18.0	M10	142	-	-	385	405	366	410	-	141	316	M6	
4EU43	194	15.0	22.0	M12	168	-	-	435	458	416	460	-	155	356	M6	
4EU45	221	15.0	22.0	M12	182	-	-	435	458	416	460	-	182	356	M6	
4EU47	251	15.0	22.0	M12	197	-	-	435	458	416	460	-	212	356	M6	
4EU50	195	12.5	12.5	M10	220	-	-	565	533	470	518	-	158	410	M12	
4EU51	207	12.5	12.5	M10	242	-	-	565	533	470	518	-	170	410	M12	



Version up to 1000 A



Version > 1000 A

Flat termination	a ₁	a ₂	a ₃ Al	a ₃ Cu	a ₄	a ₅	a ₆	a ₇	a _{8 max.}
for 4EU24 to 4EU36 with flat terminations, for arrangement of reactors on horizontal surfaces									
≤ 200 A	20	20	4	3	10.0	9	-	-	34
≤ 400 A	25	25	6	5	12.5	11	-	-	41
≤ 630 A	30	30	8	6	15.0	11	-	-	48
≤ 800 A	30	30	10	8	15.0	14	-	-	50
≤ 1000 A	40	40	10	8	20.0	14	-	-	60
≤ 1250 A	50	50	10	8	14.0	14	22	22	70

for 4EU39 to 4EU51 with flat terminations, for arrangement of reactors on horizontal surfaces									
≤ 200 A	35	20	-	3	10.0	9	-	-	-
≤ 400 A	35	30	-	5	12.5	11	-	-	-
≤ 630 A	40	30	-	6	15.0	11	-	-	-
≤ 800 A	40	30	-	8	15.0	14	-	-	-
≤ 1000 A	50	40	-	8	20.0	14	-	-	-
≤ 1250 A	50	50	-	8	14.0	14	22	22	-
≤ 1640 A	60	60	-	12	17.0	14	26	26	-